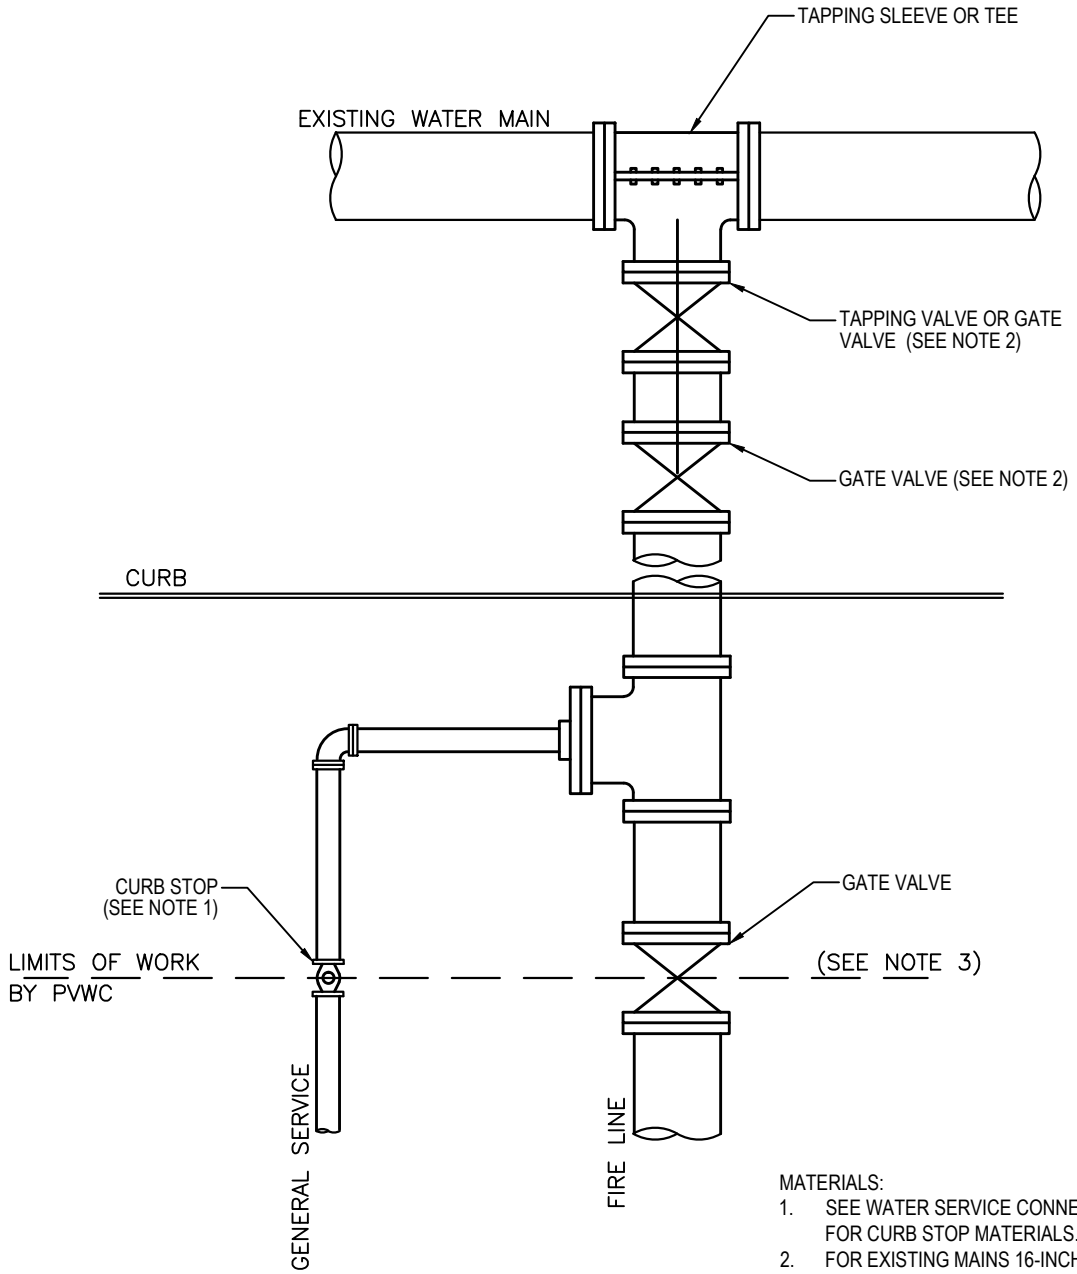

MATERIALS:

1. SEE WATER SERVICE CONNECTION UP TO 2" DETAIL FOR CURB STOP MATERIALS.
2. FOR EXISTING MAINS 16-INCHES OR GREATER IN DIAMETER, THE TAPPING VALVE OR GATE VALVE SHALL BE BURIED AND A SECOND GATE VALVE SHALL BE CONSTRUCTED.
3. THERE SHALL BE NO INTERCONNECTION BETWEEN THE GENERAL SERVICE AND THE FIRE LINE AND NO CONNECTION OF THE GENERAL SERVICE TO THE FIRE LINE AFTER THE CURB STOP OR GATE VALVE..

GENERAL AND FIRE SERVICE

(NOT TO SCALE)

PASSAIC VALLEY WATER COMMISSION 1525 MAIN AVE. CLIFTON, N.J. TEL:(973) 340-4300		
GENERAL AND FIRE SERVICE		
TYPICAL DETAIL		
DESIGNED BY:		DATE: 6/5/20
DRAWN BY: PAD		SCALE: NOT TO SCALE
CHECKED BY: B.F.		DWG. 1 OF 1

\\ENG\PVWC References Drive\0_Master Documents and Forms\4_Construction Details\cad\water details.dwg, 6/5/2020 9:01:07 AM